



Single Microswitch EOL (End of Line) Device

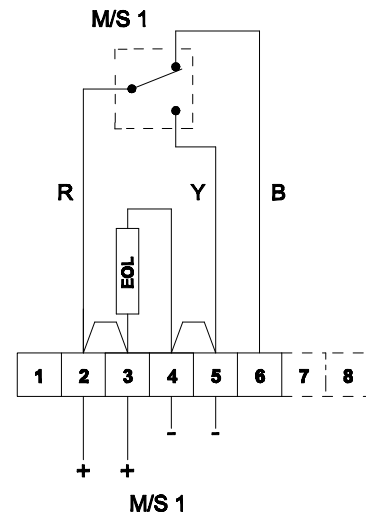


**1A - Circuit shown in Unoperated condition
(Glass Intact / Standby Condition)**
Terminals +(2,3) & -(4,5) open
Terminals +(2,3) & (6) closed

Single Microswitch Series Device

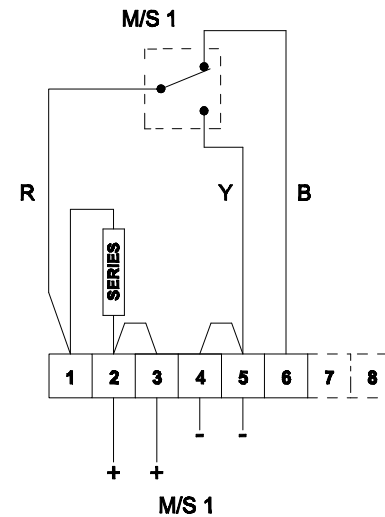


**2A - Circuit shown in Unoperated condition
(Glass Intact / Standby Condition)**
Terminals +(2,3) & -(4,5) open
Terminals +(2,3) & (6) closed

Single Microswitch EOL & Series Device

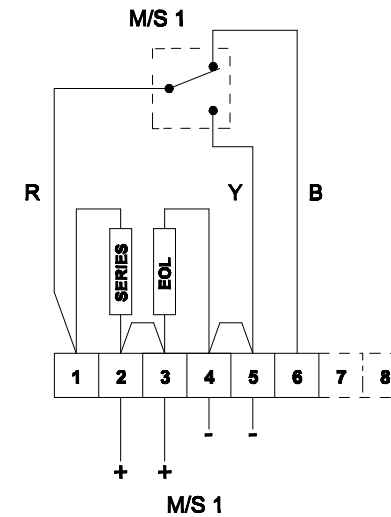


**3A - Circuit shown in Unoperated condition
(Glass Intact / Standby Condition)**
Terminals +(2,3) & -(4,5) open
Terminals +(2,3) & (6) closed


Single Microswitch EOL & Series Device Wiring Option 2

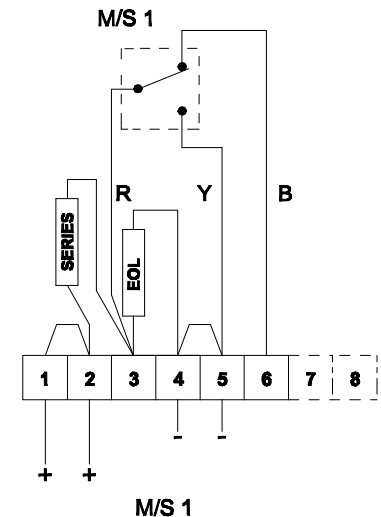


**4A - Circuit shown in Unoperated condition
(Glass Intact / Standby Condition)**
Terminals +(1,2) & -(4,5) M/S 1 open
Terminals +(1,2) & (6) M/S 1 closed

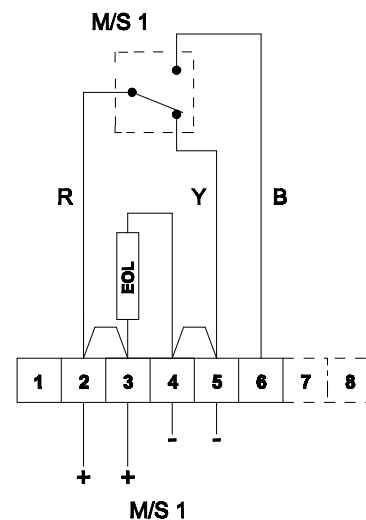


**1B - Circuit shown in Operated condition
(Glass Broken / Button pushed in)**
Terminals +(2,3) & -(4,5) closed
Terminals +(2,3) & (6) open

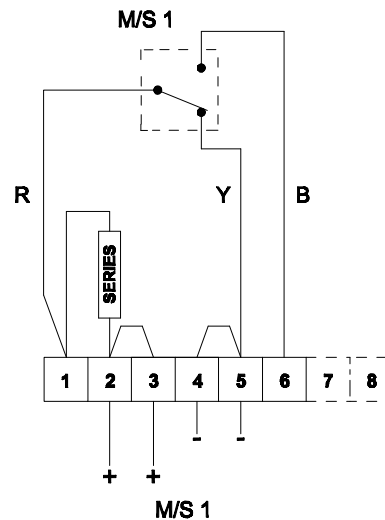

**2B - Circuit shown in Operated condition
(Glass Broken / Button pushed in)**
Terminals +(2,3) & -(4,5) closed
Terminals +(2,3) & (6) open

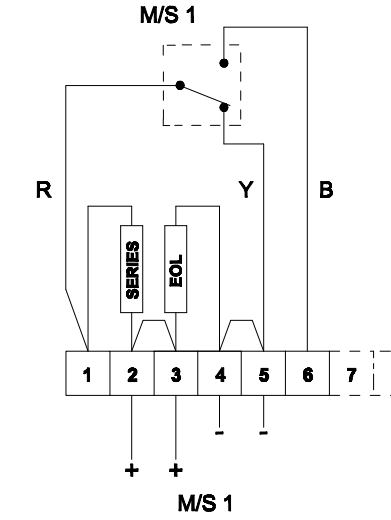

**3B - Circuit shown in Operated condition
(Glass Broken / Button pushed in)**
Terminals +(2,3) & -(4,5) closed
Terminals +(2,3) & (6) open

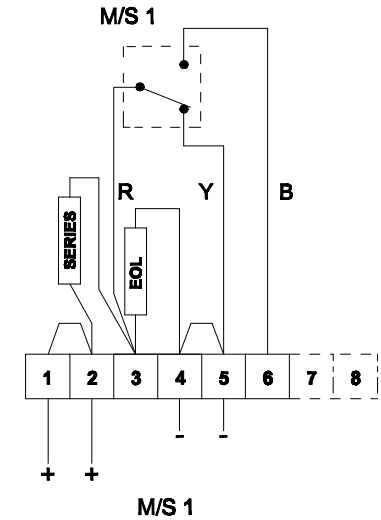

**4B - Circuit shown in Operated condition
(Glass Broken / Button pushed in)**
Terminals +(1,2) & -(4,5) M/S 1 closed
Terminals +(1,2) & (6) M/S 1 open

Additional Schematics on Sheet 2

Note: Content is for general information only and is subject to change without notification.

THIS DRAWING IS CONFIDENTIAL AND COPYRIGHT PROPERTY OF THE MANUFACTURER AND MUST NOT BE COPIED OR LENT WITHOUT PERMISSION


Customer:
Project:
PO#
Reference:
Date:

Drawing: D154-06-051 **REV:** 01
Title: **GNECP6-PB Push Button Manual Call Point**
GNECP6B/C/D-BG/PB/PT Manual Call Point
Wiring Schematic
DATE: 07/02/20 **DWG BY:** PRDCM

ProDetec
Measure . Prevent . Protect . Control


ProDetec Pty.Ltd.
P. +61 (02) 9620 8700
F. +61 (02) 9620 8755
E. info@prodetec.com.au
A. 17/38 Powers Rd,
Seven Hills NSW 2147
www.prodetec.com.au

**Dual Microswitch
EOL (End of Line) Device**

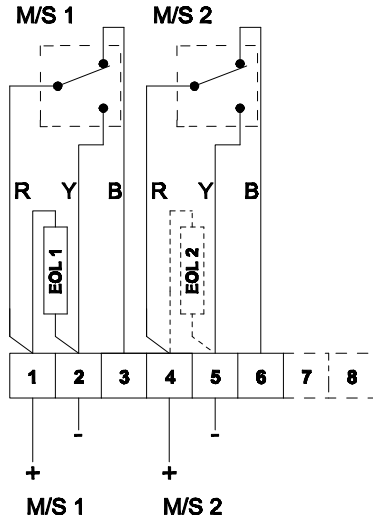


**5A - Circuit shown in Unoperated condition
(Glass Intact / Standby Condition)**
Terminals+ (1) & -(2) M/S 1 and +(4) & -(5) M/S 2 open
Terminals +(1) & (3) M/S 1 and +(4) & (6) M/S 2 closed

**Single Microswitch
L.E.D, EOL & Series Device**

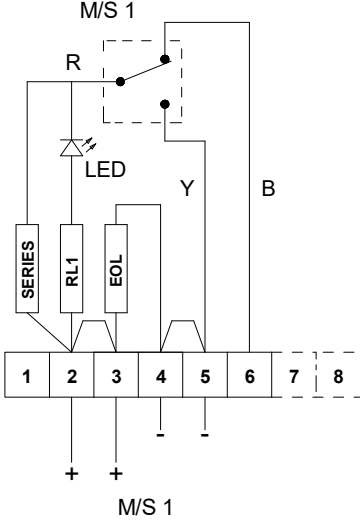


**6A - Circuit shown in Unoperated condition
(Glass Intact / Standby Condition)**
Terminals +(2,3) & -(4,5) open
Terminals +(2,3) & (6) closed

**(DIN Rail Only)
Dual Microswitch
Series Device**

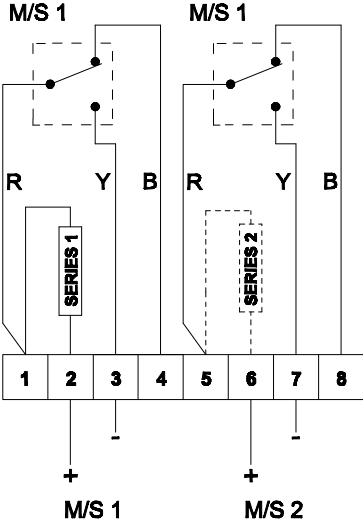


**7A - Circuit shown in Unoperated condition
(Glass Intact / Standby Condition)**
Terminals +(2,3) & -(4,5) open
Terminals +(2,3) & (6) closed


**(DIN Rail Only)
Dual Microswitch
EOL & Series Device**

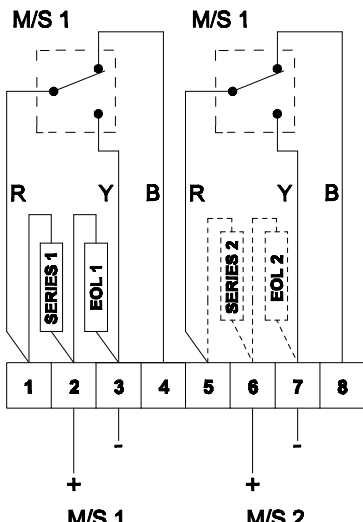


**8A - Circuit shown in Unoperated condition
(Glass Intact / Standby Condition)**
Terminals +(2) & -(3) M/S 1 and +(6) & -(7) M/S 2 open
Terminals +(2) & (4) M/S 1 and +(6) & (8) M/S 2 closed

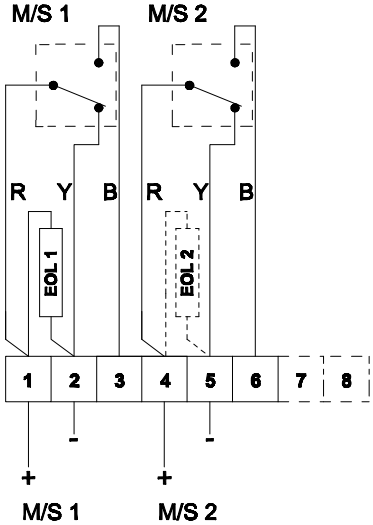


**5B - Circuit shown in Operated condition
(Glass Broken / Button pushed in)**
Terminals+ (1) & -(2) M/S 1 open and +(4) & -(5) M/S 2 closed
Terminals +(1) & (3) M/S 1 and +(4) & (6) M/S 2 open

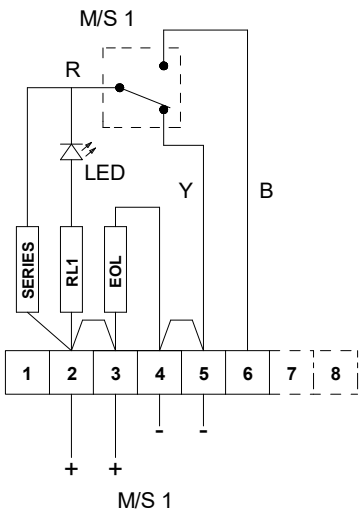

**6B - Circuit shown in Operated condition
(Glass Broken / Button pushed in)**
Terminals +(2,3) & -(4,5) closed
Terminals +(2,3) & (6) open

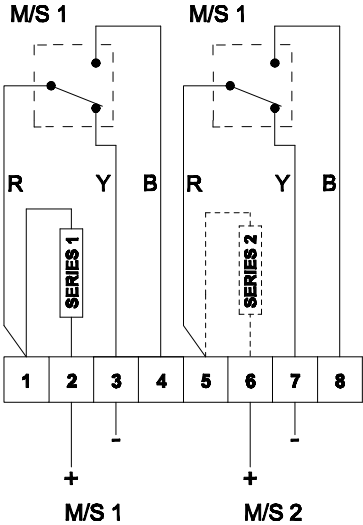

**7B - Circuit shown in Operated condition
(Glass Broken / Button pushed in)**
Terminals +(2) & -(3) M/S 1 and +(6) & -(7) M/S 2 closed
Terminals +(2) & (4) M/S 1 and +(6) & (8) M/S 2 open

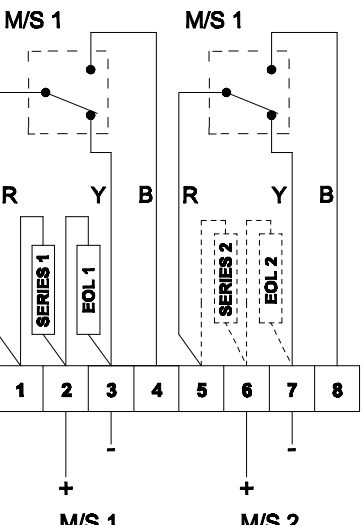

**8B - Circuit shown in Operated condition
(Glass Broken / Button pushed in)**
Terminals +(2) & -(3) M/S 1 and +(6) & -(7) M/S 2 closed
Terminals +(2) & (4) M/S 1 and +(6) & (8) M/S 2 open

Note: Content is for general information only and is subject to change without notification.

THIS DRAWING IS CONFIDENTIAL AND COPYRIGHT PROPERTY OF THE MANUFACTURER AND MUST NOT BE COPIED OR LENT WITHOUT PERMISSION

Customer:
Project:
PO#
Reference:
Date:

Drawing: D154-06-051 REV: 01
Title: **GNECP6-PB Push Button Manual Call Point**
GNECP6B/C/D-BG/PB/PT Manual Call Point
Wiring Schematic
DATE: 07/02/20 **DWG BY:** PRDCM

ProDetec
Measure . Prevent . Protect . Control

ProDetec Pty.Ltd.
P. +61 (02) 9620 8700
F. +61 (02) 9620 8755
E. info@prodetec.com.au
A. 17/38 Powers Rd,
Seven Hills NSW 2147
www.prodetec.com.au