



### Single Microswitch EOL (End of Line) Device

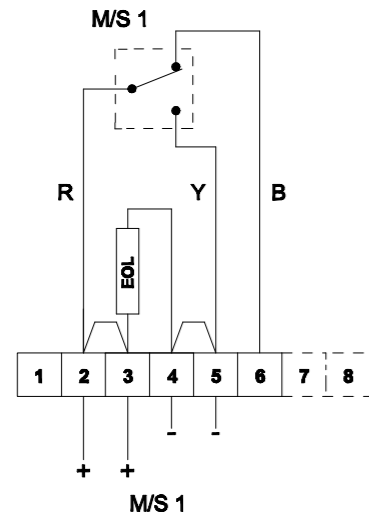


**1A - Circuit shown in Unoperated condition  
(Glass Intact / Standby Condition)**  
Terminals +(2,3) & -(4,5) open  
Terminals +(2,3) & (6) closed

### Single Microswitch Series Device

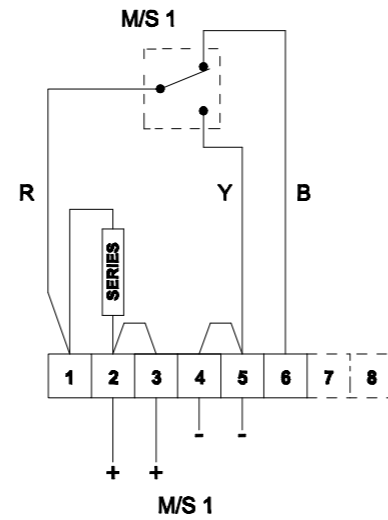


**2A - Circuit shown in Unoperated condition  
(Glass Intact / Standby Condition)**  
Terminals +(2,3) & -(4,5) open  
Terminals +(2,3) & (6) closed

### Single Microswitch EOL & Series Device

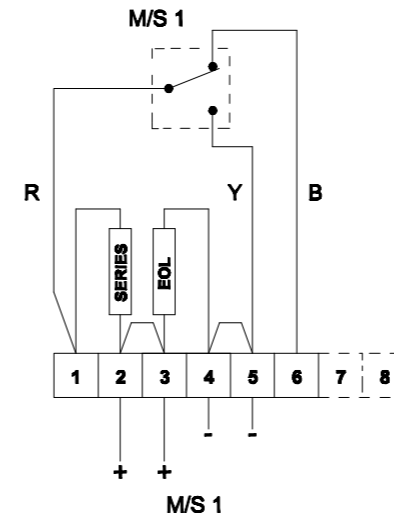


**3A - Circuit shown in Unoperated condition  
(Glass Intact / Standby Condition)**  
Terminals +(2,3) & -(4,5) open  
Terminals +(2,3) & (6) closed


### Single Microswitch EOL & Series Device Wiring Option 2

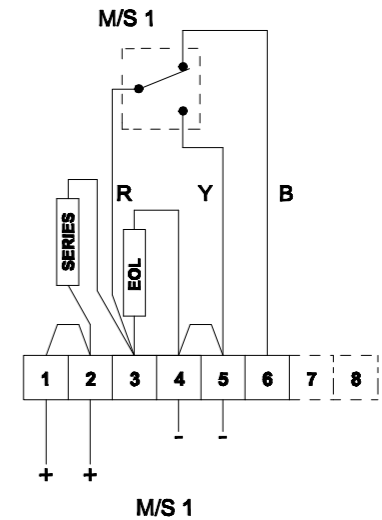


**4A - Circuit shown in Unoperated condition  
(Glass Intact / Standby Condition)**  
Terminals +(1,2) & -(4,5) M/S 1 open  
Terminals +(1,2) & (6) M/S 1 closed

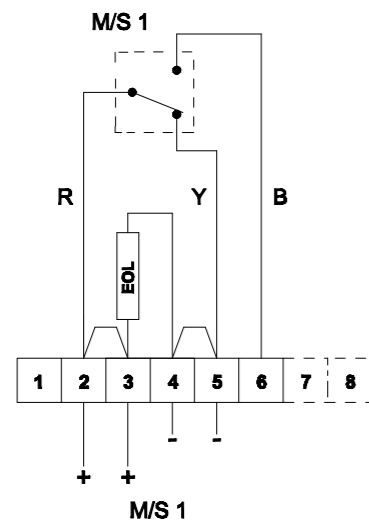


**1B - Circuit shown in Operated condition  
(Glass Broken / Button pushed in)**  
Terminals +(2,3) & -(4,5) closed  
Terminals +(2,3) & (6) open

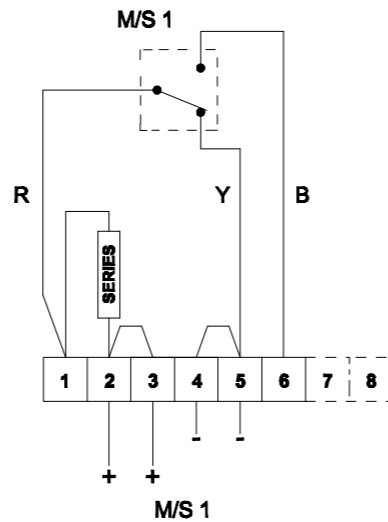

**2B - Circuit shown in Operated condition  
(Glass Broken / Button pushed in)**  
Terminals +(2,3) & -(4,5) closed  
Terminals +(2,3) & (6) open

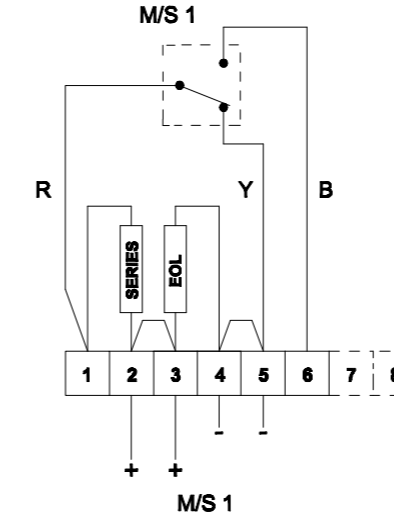

**3B - Circuit shown in Operated condition  
(Glass Broken / Button pushed in)**  
Terminals +(2,3) & -(4,5) closed  
Terminals +(2,3) & (6) open

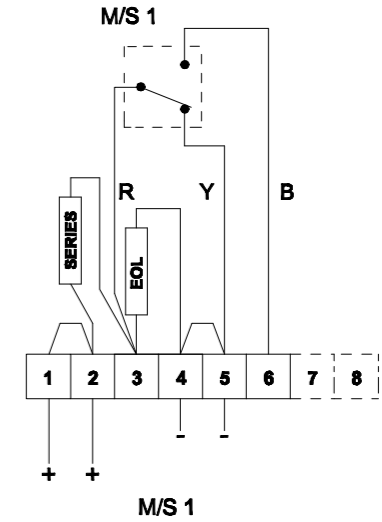

**4B - Circuit shown in Operated condition  
(Glass Broken / Button pushed in)**  
Terminals +(1,2) & -(4,5) M/S 1 closed  
Terminals +(1,2) & (6) M/S 1 open

### Additional Schematics on Sheet 2

Note: Content is for general information only and is subject to change without notification.


THIS DRAWING IS CONFIDENTIAL AND COPYRIGHT PROPERTY OF THE MANUFACTURER AND MUST NOT BE COPIED OR LENT WITHOUT PERMISSION

<b>Customer:</b>	<b>Drawing:</b> D154-06-051	<b>REV:</b> 01
<b>Project:</b>	<b>Title:</b> <b>GNECP6-PT Push Button Tool Reset Call Point</b>	
<b>PO#</b>	<b>GNECP6B/C/D-BG/PB/PT Manual Call Point</b>	
<b>Reference:</b>	<b>Wiring Schematic</b>	
<b>Date:</b>	<b>DATE:</b> 07/02/20	<b>DWG BY:</b> PRDCM




**ProDetec Pty.Ltd.**  
P. +61 (02) 9620 8700  
F. +61 (02) 9620 8755  
E. info@prodetec.com.au  
A. 17/38 Powers Rd,  
Seven Hills NSW 2147  
[www.prodetec.com.au](http://www.prodetec.com.au)

**Dual Microswitch  
EOL (End of Line) Device**

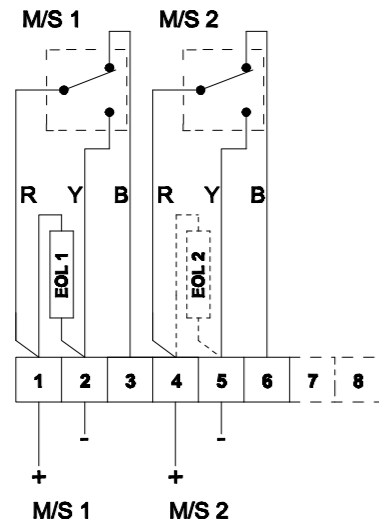


**5A - Circuit shown in Unoperated condition  
(Glass Intact / Standby Condition)**  
Terminals + (1) & -(2) M/S 1 and +(4) & -(5) M/S 2 open  
Terminals +(1) & (3) M/S 1 and +(4) & (6) M/S 2 closed

**Single Microswitch  
L.E.D, EOL & Series Device**

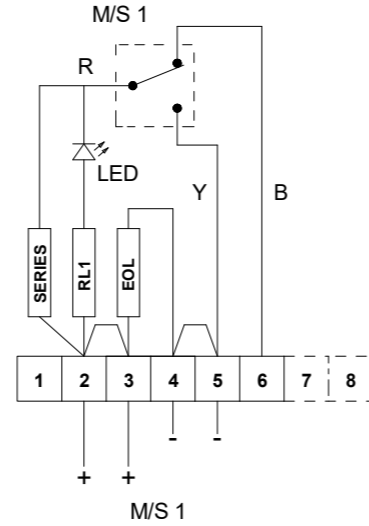


**6A - Circuit shown in Unoperated condition  
(Glass Intact / Standby Condition)**  
Terminals +(2,3) & -(4,5) open  
Terminals +(2,3) & (6) closed

**(DIN Rail Only)  
Dual Microswitch  
Series Device**

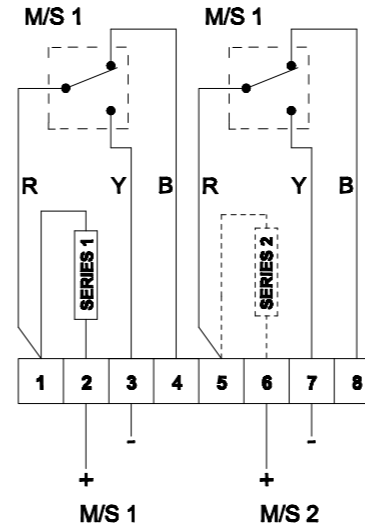


**7A - Circuit shown in Unoperated condition  
(Glass Intact / Standby Condition)**  
Terminals +(2,3) & -(4,5) open  
Terminals +(2,3) & (6) closed


**(DIN Rail Only)  
Dual Microswitch  
EOL & Series Device**

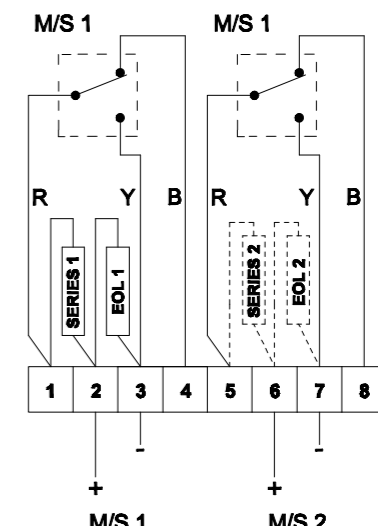


**8A - Circuit shown in Unoperated condition  
(Glass Intact / Standby Condition)**  
Terminals +(2) & -(3) M/S 1 and +(6) & -(7) M/S 2 open  
Terminals +(2) & (4) M/S 1 and +(6) & (8) M/S 2 closed

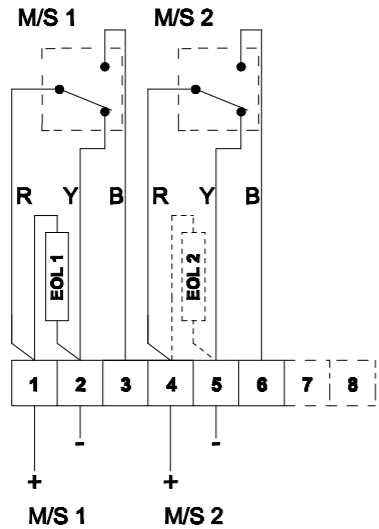


**5B - Circuit shown in Operated condition  
(Glass Broken / Button pushed in)**  
Terminals + (1) & -(2) M/S 1 open and +(4) & -(5) M/S 2 closed  
Terminals +(1) & (3) M/S 1 and +(4) & (6) M/S 2 open

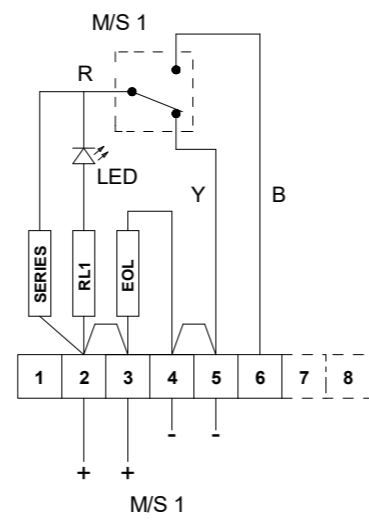

**6B - Circuit shown in Operated condition  
(Glass Broken / Button pushed in)**  
Terminals +(2,3) & -(4,5) closed  
Terminals +(2,3) & (6) open

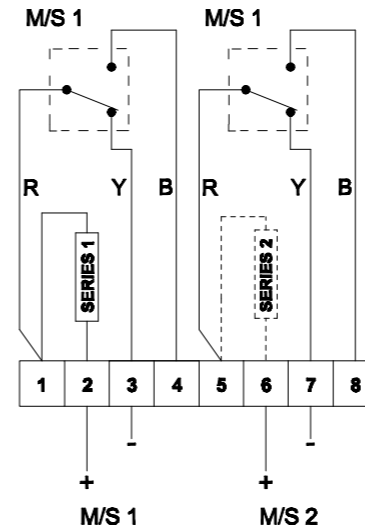

**7B - Circuit shown in Operated condition  
(Glass Broken / Button pushed in)**  
Terminals +(2) & -(3) M/S 1 and +(6) & -(7) M/S 2 closed  
Terminals +(2) & (4) M/S 1 and +(6) & (8) M/S 2 open

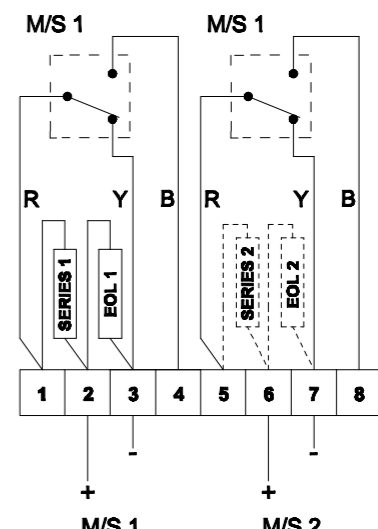

**8B - Circuit shown in Operated condition  
(Glass Broken / Button pushed in)**  
Terminals +(2) & -(3) M/S 1 and +(6) & -(7) M/S 2 closed  
Terminals +(2) & (4) M/S 1 and +(6) & (8) M/S 2 open

Note: Content is for general information only and is subject to change without notification.

THIS DRAWING IS CONFIDENTIAL AND COPYRIGHT PROPERTY OF THE MANUFACTURER AND MUST NOT BE COPIED OR LENT WITHOUT PERMISSION

<b>Customer:</b>	<b>Drawing:</b> D154-06-051	<b>REV:</b> 01
<b>Project:</b>	<b>Title:</b> <b>GNEExCP6-PT Push Button Tool Reset Call Point</b>	
<b>PO#</b>	<b>GNEExCP6B/C/D-BG/PB/PT Manual Call Point</b>	
<b>Reference:</b>	<b>Wiring Schematic</b>	
<b>Date:</b>	<b>DATE:</b> 07/02/20	<b>DWG BY:</b> PRDCM



**ProDetec Pty.Ltd.**  
P. +61 (02) 9620 8700  
F. +61 (02) 9620 8755  
E. info@prodetec.com.au  
A. 17/38 Powers Rd,  
Seven Hills NSW 2147  
[www.prodetec.com.au](http://www.prodetec.com.au)